



Catálogo

Acumulador de succión con Intercambiador



www.rgcrefrigeration.com

ACUMULADOR DE SUCCIÓN

Con Intercambiador

Con el Acumulador de Succión con Intercambiador de RGC, obtiene tanto protección como rendimiento en un solo componente, asegurando un funcionamiento más confiable y eficiente de su sistema



El Acumulador de Succión con Intercambiador de Calor de la serie FDQE de RGC es una solución ingeniosa que combina la función esencial de protección del compresor con la eficiencia del intercambio de calor.

Diseñado para evitar daños al compresor causados por inundaciones repentinas de refrigerante en fase líquida, este innovador dispositivo también subenfía la línea de líquido, mejorando la eficiencia global de su sistema de refrigeración.


Especificaciones Técnicas

Carcasa	
Hermética	
Refrigerantes Compatibles	
HCFC-HFC-HFO-HC	
Presión Máxima de trabajo	
30 bar/ 435 psig	
Rango de Temperatura	
-40 °C a 70°C	

Aplicaciones

Refrigeración Comercial	
Refrigeración Industrial	

Modelo	Diámetro de conexión de Succión	Diámetro de conexión de Líquido	Dimensiones							Capacidad Nominal con R404A		Volumen
			ΦD	A	B	E	F	H	M	kW		
										-18°C	5°C	
FDQE-207	7/8	1/2	140	33	28	80	70	353	M10	9.5	16.2	4.5
FDQE-208	1-1/8	1/2	159	38	28	80	95	438	M12	15.5	26.7	7.2
FDQE-208	1-1/8	5/8	159	38	28	80	95	438	M12	15.5	26.7	7.2
FDQE-209	1-3/8	5/8	159	40	30	80	80	570	M12	25.3	42.9	9.5
FDQE-210	1-5/8	3/4	159	43	32	80	80	623	M12	32.6	53	10.5
FDQE-211	2-1/8	7/8	159	45	35	80	80	625	M12	42.8	75.3	10.5

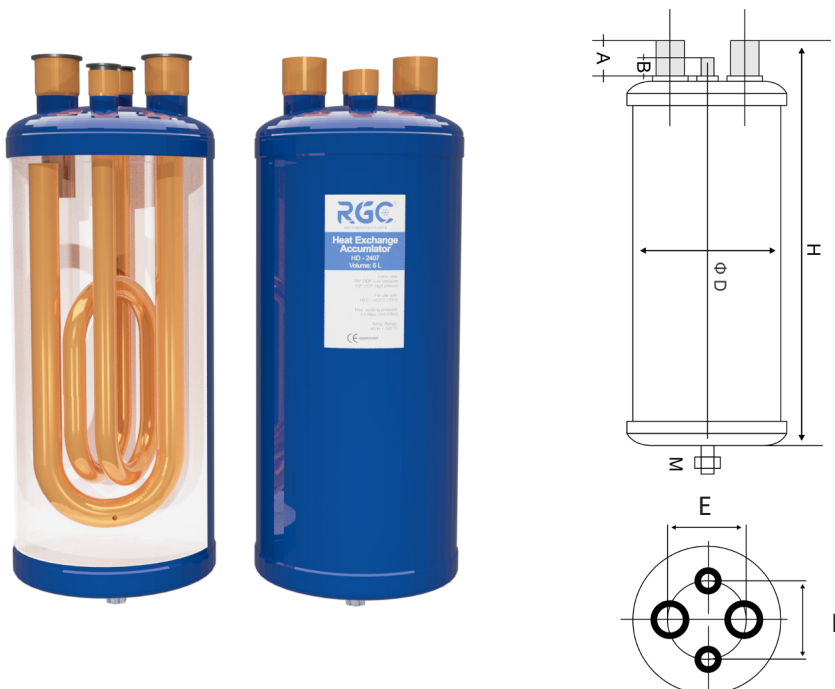

VERIFICATION OF CONFORMITY

Certificate No.: B-S2406C2384

Client ID: CC6590

Beide
Compliance Laboratory

Holder.....: RGC REFRIGERATION PARTS C.A. CORP

Address.....: 2200 NW 72ND AVE #523223MIAMI, FL.33152

Manufacturer.....: Same As Holder

Trade Mark.....:



Product.....: Suction Line Accumulators

Model No.....: FDQE-207,FDQE-208,FDQE-209,FDQE-210,FDQE-211,FDQ-205,
FDQ-206,FDQ-207,FDQ-208,FDQ-209,FDQ-210,FDQ-211

Verification to.....: European Directive(s): Pressure Equipment Directive 2014/68/EU
EN 13445-1:2021

The test results apply only to the particular sample tested and to the specific tests carried out. Technical Report and documentation are at the Holder's disposal.

This certificate applies specifically to the sample investigated in our test reference number only. The CE markings as shown below can be affixed on the product after preparation of necessary technical documentation. Other relevant Directives have to be observed.

Date of issue: 2024-06-25

Expiry date: 2027-06-25



A handwritten signature in black ink, appearing to read 'Anthony'.

Certification Manager



Beide (Shenzhen) Product Service Limited

Address: 6F, Bldg E, Hourui 3rd Ind Zone, Xixiang, Bao'an Dist, Shenzhen, China

E-mail: admin@szbeide.com Phone: +86 0755 27454498 www.szbeide.com

