

HYB60MHU42 COMPRESSOR

TECHNICAL SPECIFICATION

(115V~60Hz)

CHANGHONG HUA-YI COMPRESSOR CO., LTD.

INDEX

	page
1、 Compressor Type.....	2
2、 Performance Data.....	2
3、 Running Condition.....	2
4、 Compressor Mechanical Information.....	3
5、 Compressor Shape.....	3
6、 Wiring Diagram.....	4
7、 Assembly of starter and protector.....	5-6
8、 Delivery State.....	6
9、 Package、 Storage and Transportation.....	7
10、 Technical Items.....	7

1. Compressor Type

Compressor model	HYB60MHU42
Rated voltage/frequency	115V~60Hz
Refrigerant	R600a
Application	Low back pressure (LBP)
Cooling method	natural Cooling
Control device	Capillary tube
Motor type	RSIR(PTC)
Capacitor	None

2. Performance Date

Displ.(cm ³)	Capacity(W) ≥95%	Inp.Pow.(W) ≤115%	Rated Current(A) ≤110%	COP (W/W) ≥95%
6.0	120	85.7	1.12	1.40

Testing condition:

Test conditions	LBP
	ASHRAE
Evaporating Temp.	-23.3℃
Ambient Temp.	32.2℃
Condensing Temp.	54.4℃
Suction Temp.	32.2℃
Subcooling Temp.	32.2℃


3. Running Condition

Ambient temp.	10~43℃
Evaporating temp.	-35~-15℃
Voltage range	98~127V
Max. condensing temp.	65℃
Max. winding temp.	130℃
Max. shell temp.	95℃
Max. discharge temp.	110℃

4. Compressor Mechanical Information


Oil charged	130±10ml
Diameter of suction tube (I.D.)	$\Phi 6.1^{+0.1}_0$ mm
Diameter of discharge tube(I.D.)	$\Phi 4.9^{+0.1}_0$ mm
Diameter of process tube (I.D.)	$\Phi 6.1^{+0.1}_0$ mm
Material of suction tube, process tube and discharge tube	copper tube
Compressor noise	≤39dB(A)
Vibration	≤0.7m/s ²

5. Compressor Shape (connection on suction and process can not be inverted)

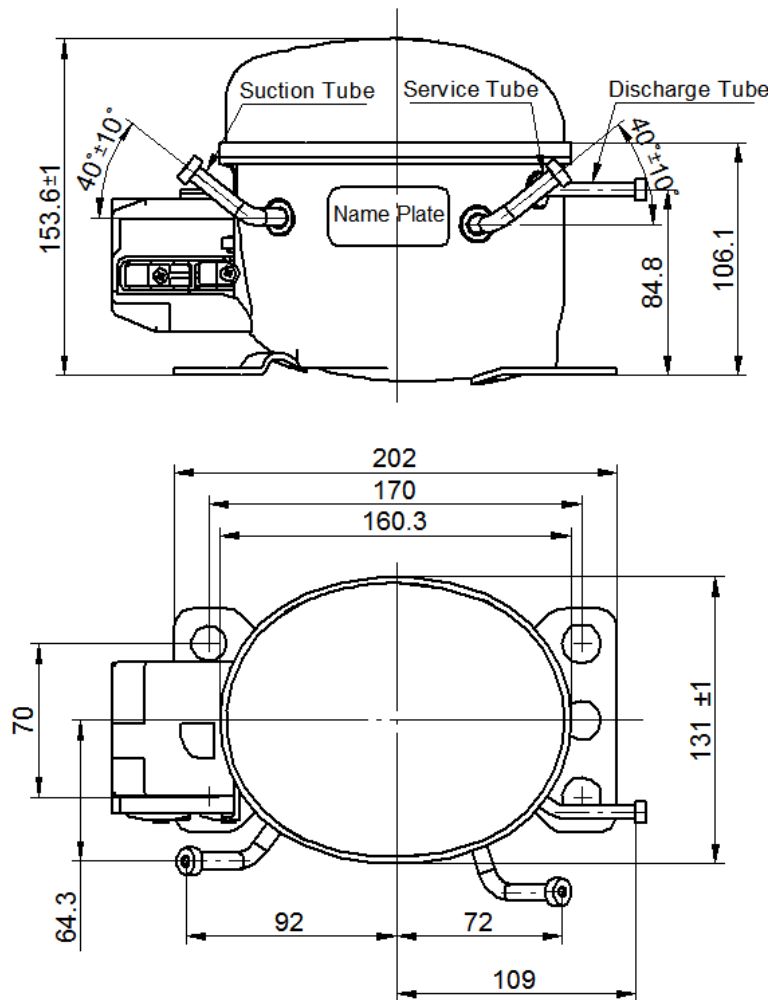

6. Wiring Diagram

RSIR:

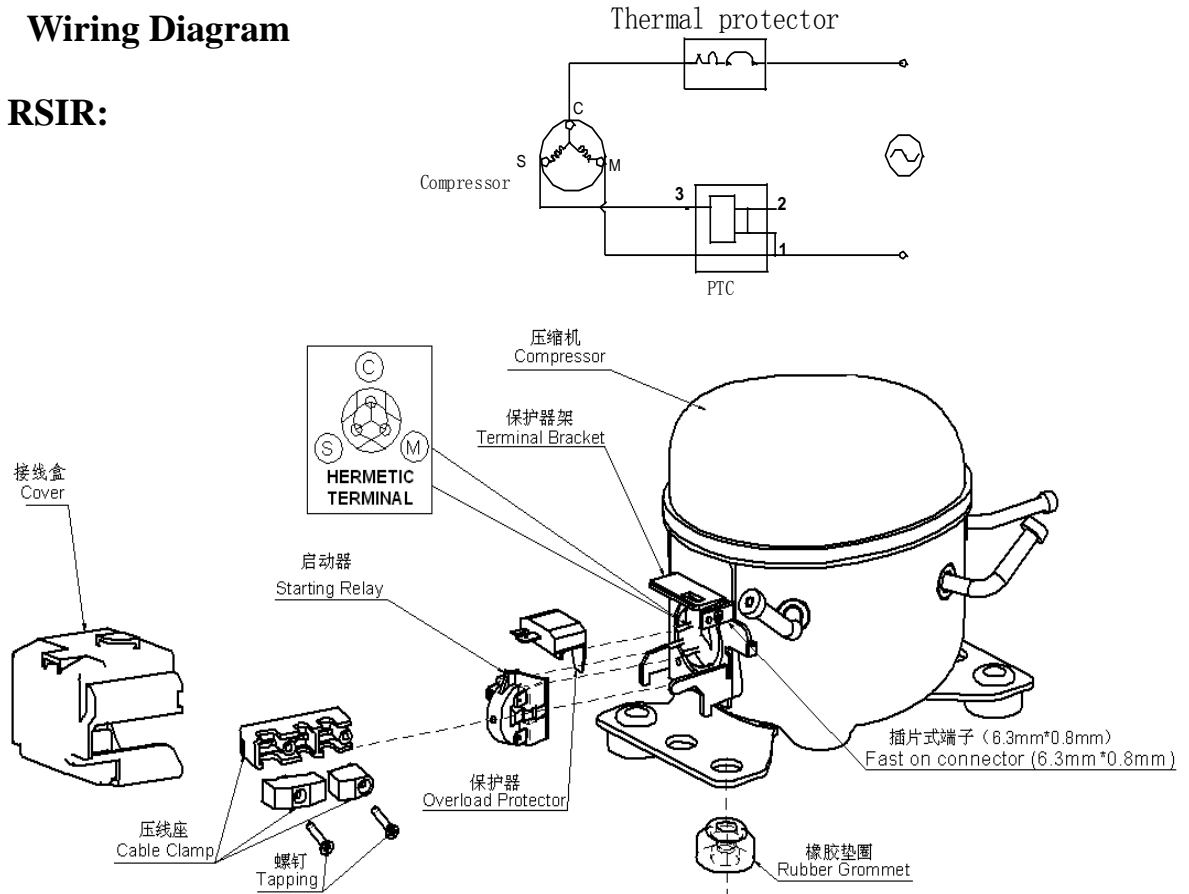

Note: Each of the starting relay, the thermal protector, the spring tap, the terminal cover and the screw assembly is separately provided by our company.

7. Starter and protector

7.1 Starting relay


Model: QP2-4R7、QP2-4.7

Type: Starting relay

Max current: 12A

Max working voltage: 180 V

Flammability: Anti-flammability


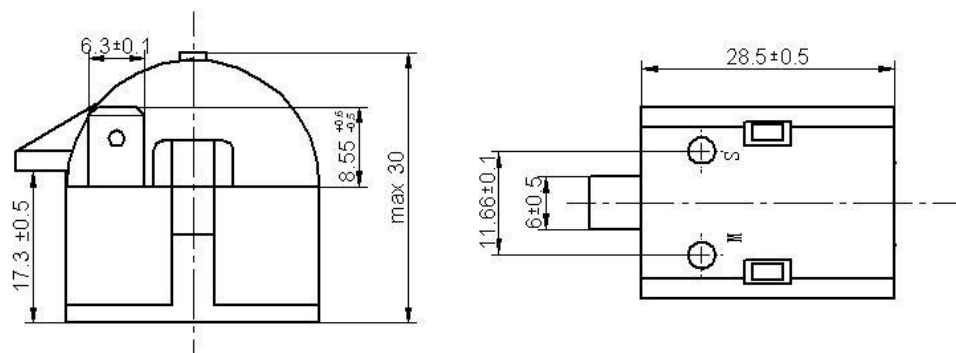


7.2 Thermal protector

Model: DRB24P61A1 、 BT68-125

Compressor model		HYB60MHU42
Thermal Protector	Max.T.C Amp.(25°C) A	6.8
	Trip time S	6~14
	Reset time S	50~150
	Open temp. $\pm 5^{\circ}\text{C}$	105
	Close temp. $\pm 9^{\circ}\text{C}$	61
	Min. T.C. Amp.(70°C) A	1.55~1.96

Flammability: Anti-flammability

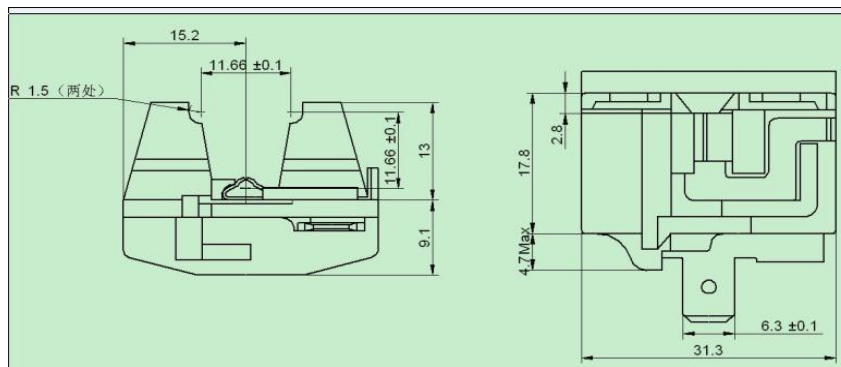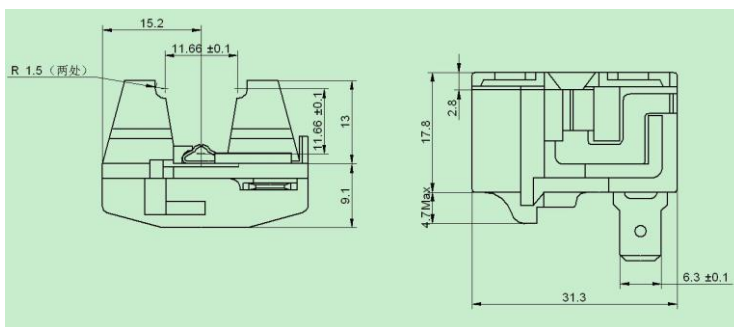

8. Delivery State

No.	Name	Model	Quantity	CODE
1.	Compressor	HYB60MHU42	1 pcs	
2.	<i>MOUNTING ACCESSORIES</i>			
2.1.	Rubber Gasket		4 pcs	E.24.12.201
2.2.	Plain Washer		4 pcs	CTE983-2
2.3.	Mounting Sleeve		4 pcs	CTE943-2
2.4.	Mounting Bolt	M6×30	4 pcs	GB5781-86
2.5.	Mounting Nut	M6	4 pcs	GB6170-86
3.1.	Starting Relay	QP2-4R7、QP2-4.7	1 pcs	
3.2.	Thermal Protector	BT68-125 、DRB24P61A1	1 pcs	
3.3.	Plastic cover		1 pcs	B. 24. 01. 59XL

3.4	Screw Assembly		1 pcs	E.14.24.201
------------	-----------------------	--	--------------	--------------------

Notes: 1.The electrical parts and equipment assembly according to Delivery states are all provided by our company.

9. Package、Storage and Transportation

Package type	Un-recycled
Quantity	105pcs/box
Transportation	By truck or train
Storage	Max. 2 layers
Volume m³	0.94
Dimension: length × width × height (cm)	1120 × 820 × 1020
Main components	Wooden supporter、foam divider、plastic sheet、cardboard cover、wrapping
Movement	Keep the compressor in normal or vertical position (a short time before compressor installed in the refrigerator).
Trans. test requirement	No allowable compressor's damage and performance loss.

10. Technical Items

1. After pulling off rubber plugs from the compressor tubes, please connect the compressor to the refrigeration system within 5 minutes. It is advisable to take off the first plug from process tube. No dust or humidity in the air is permitted to enter the compressor.
2. Earth connection should be fixed permanently and reliably.
3. The compressor must be mounted horizontally without tilting an angle more than 5° .
4. Maximum operating ambient temperature is at 43℃.
5. When the compressor starts, balance pressure inside refrigeration system must be less than 0.25Mpa (Absolute).
6. The compressor must not be restarted unless at an interval of more than 5 minutes.
7. Please keep the compressor always vertically and never upset it during transportation while avoiding any vibration and shock.
8. Please store the compressor in a dry and ventilated place and keep it away from any humidity.
9. Please follow the transportation warning marks on the package for layer limitation. Do not roll the whole packages when loading or unloading.
10. Storage expiry is 6 months from the date of production. If it expired, please check the nitrogen pressure inside compressor and recharge it when it is necessary.
11. The compressor warranty is 36 months from the date of delivery. However we are obligated to repair or replace any fault compressor resulted from either workmanship or raw materials and components if it is operated fully in compliance with this Operating Manual.